


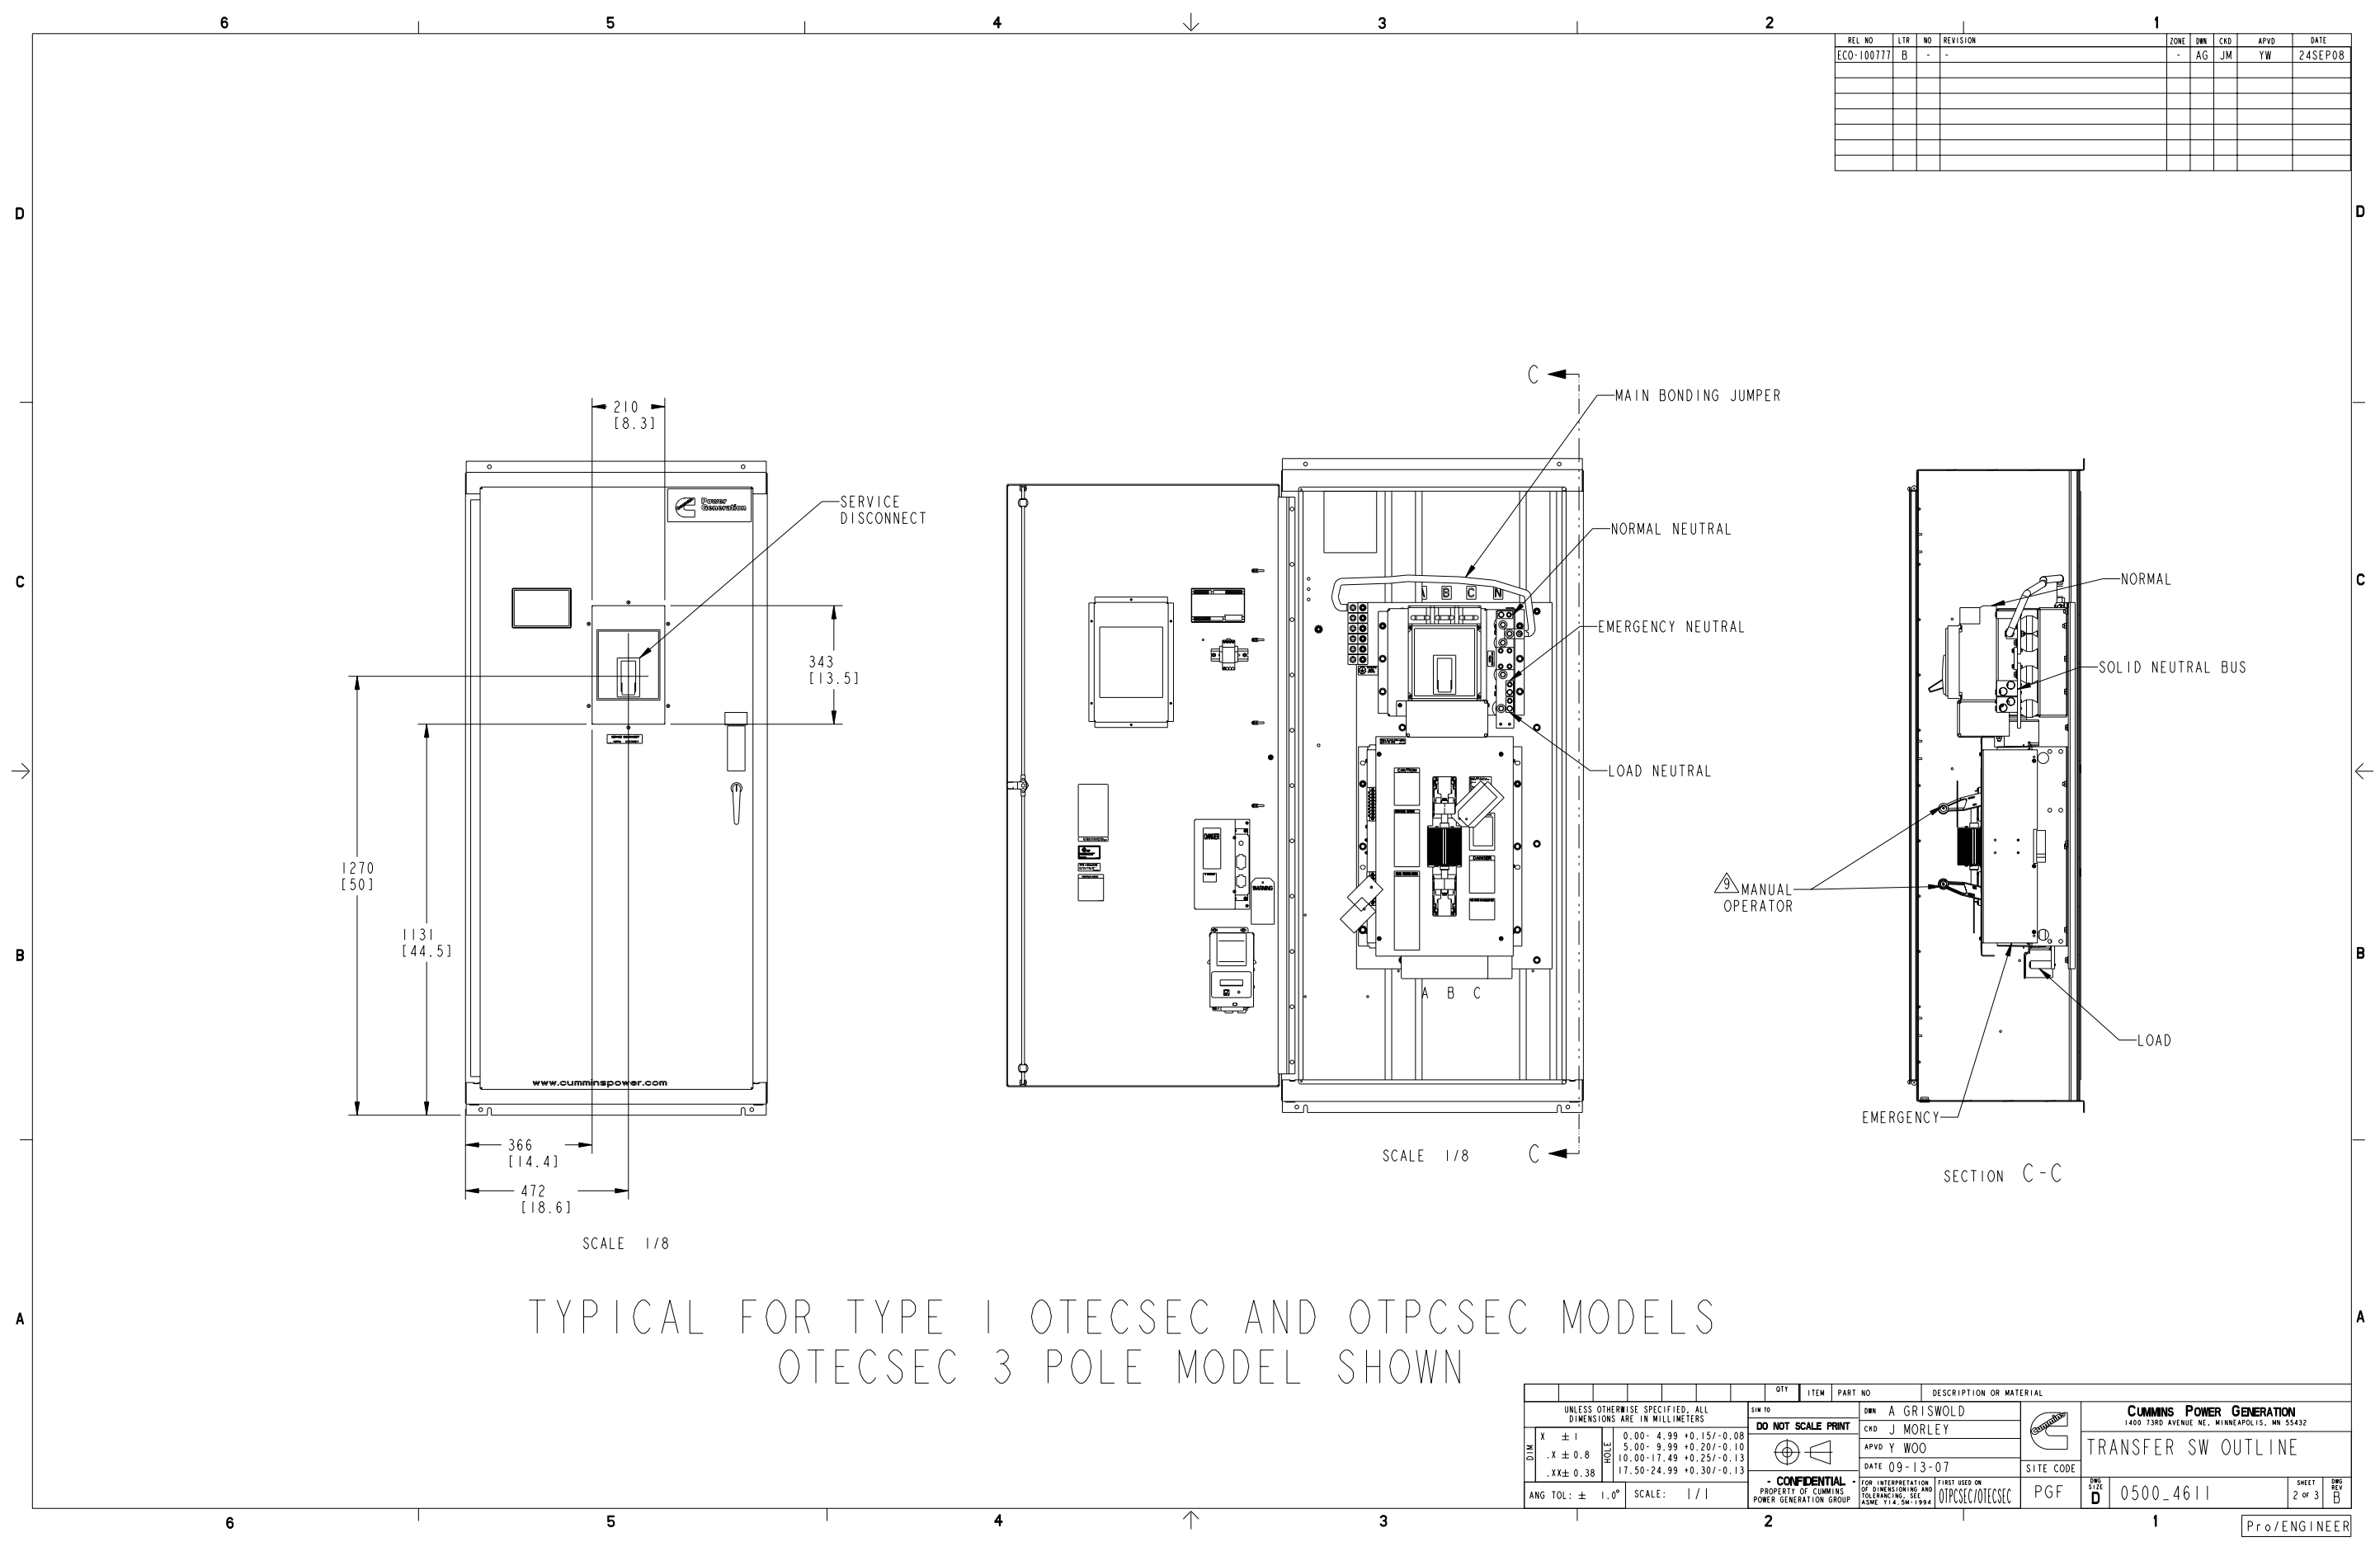

REL NO	LTR	NO	REVISION	ZONE	DWN	CKD	APVD	DATE
ECO-100777	B	-	-	-	AG	JM	YW	24SEP08

TYPICAL FOR TYPE I OTECSEC AND OTPCSEC MODELS
OTECSEC 3 POLE MODEL SHOWN

QTY	ITEM	PART NO	DESCRIPTION OR MATERIAL
UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN MILLIMETERS			
DIM	X ± 1	0.00- 4.99 +0.15/-0.08	
	.X ± 0.8	5.00- 9.99 +0.20/-0.10	
	.XX ± 0.38	10.00-17.49 +0.25/-0.13	
		17.50-24.99 +0.30/-0.13	
ANG TOL	± 1.0°	SCALE: 1/1	
SIM TO		DWN A GRISWOLD	
DO NOT SCALE PRINT		CKD J MORLEY	
		APVD Y WOO	
		DATE 09-13-07	
		SITE CODE	
		PGF	
		0500-4611	
		2 OF 3	

**CUMMINS POWER GENERATION**
1400 13RD AVENUE NE, MINNEAPOLIS, MN 55432

TRANSFER SW OUTLINE

Pro/ENGINEER

2 OF 3

Part A019L970 B

Description	Legacy Name	External Regulations	Application Status	Release Phase Code	Security Classification	Alternates
OUTLINE, TRANSFER SWITCH	0500-4611	None	Production & Service	Production	Proprietary	

Part Specifications :A019L970 B

Name	Description	Legacy Name
A019S552	DRAWING, INSTALLATION	0500-4611